





Case Study

1,23K U+4,66K U f
3K Un

BESS 5MWp 3.45MW-6.88MWh 0 Qs IRcp_ 1,22K U f

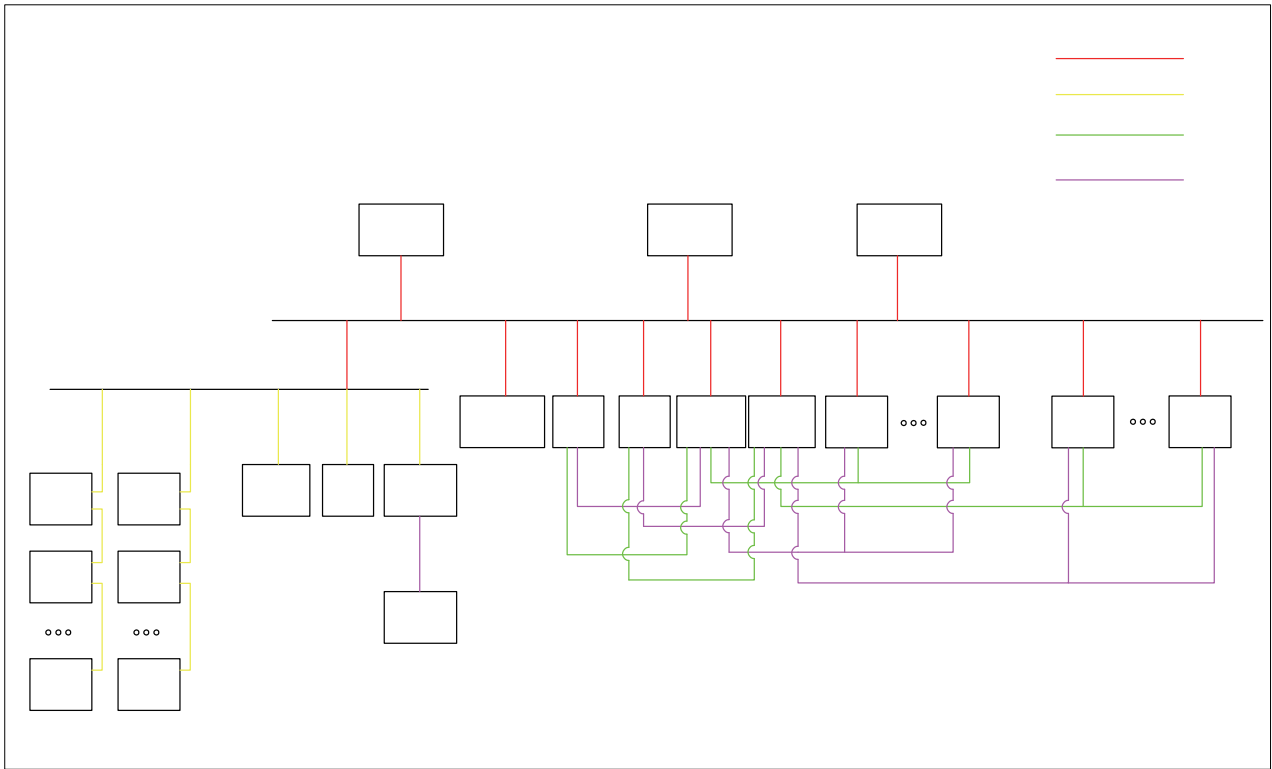

2.

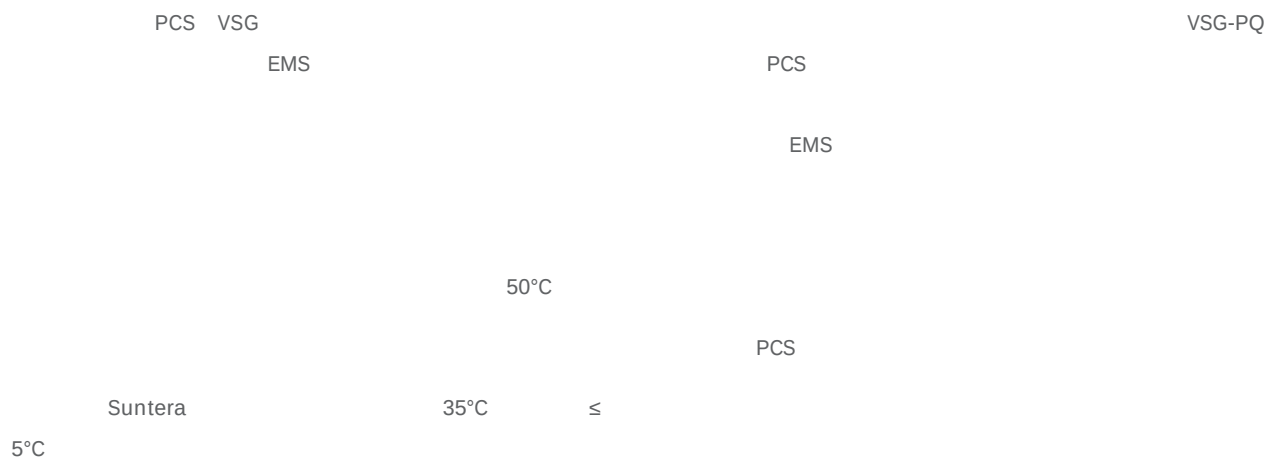

EMS


SOC 93%

707.37kW


PCS

3

789.3kW

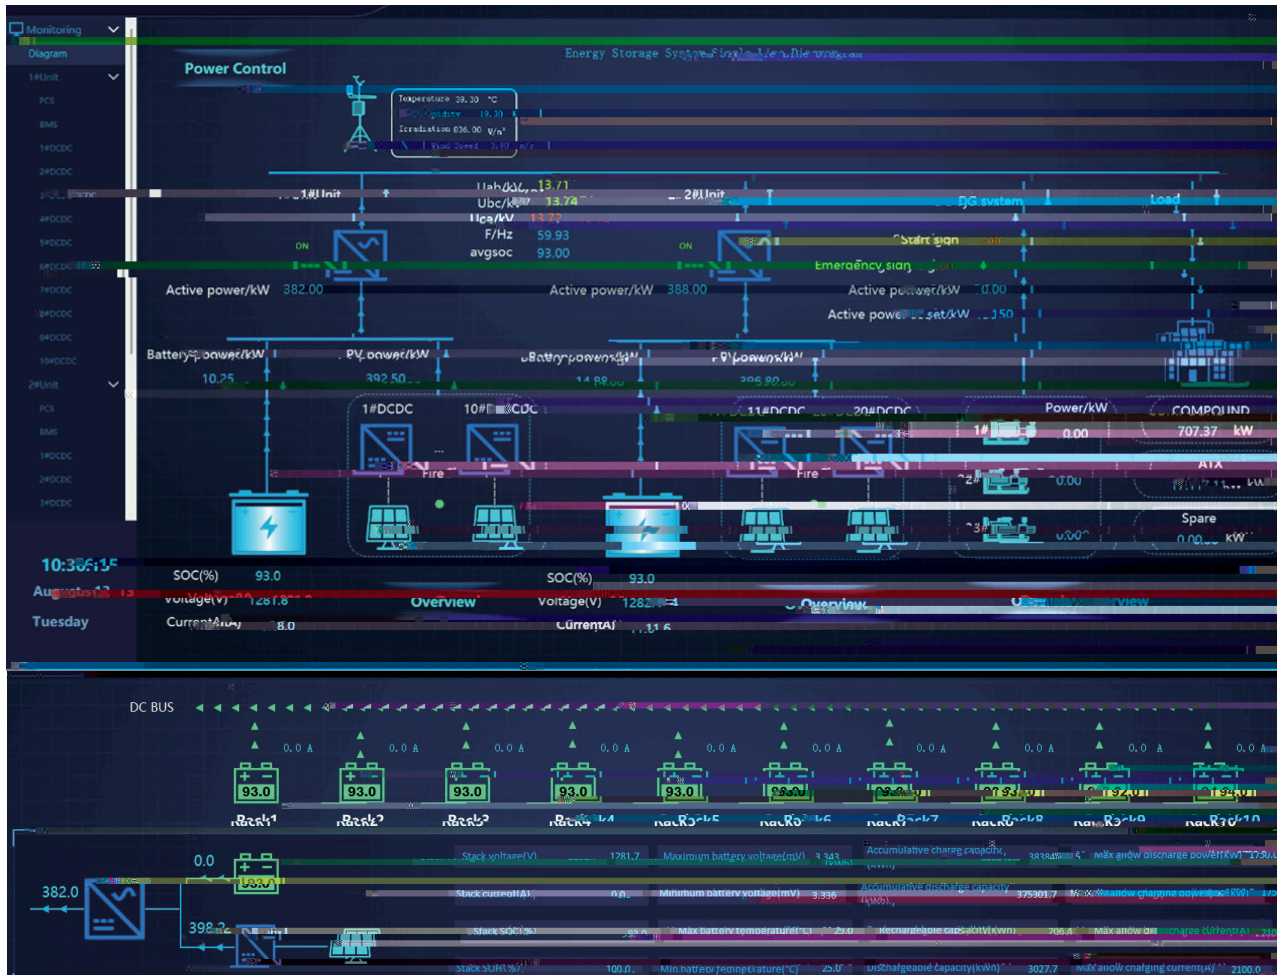


5,6. EMS

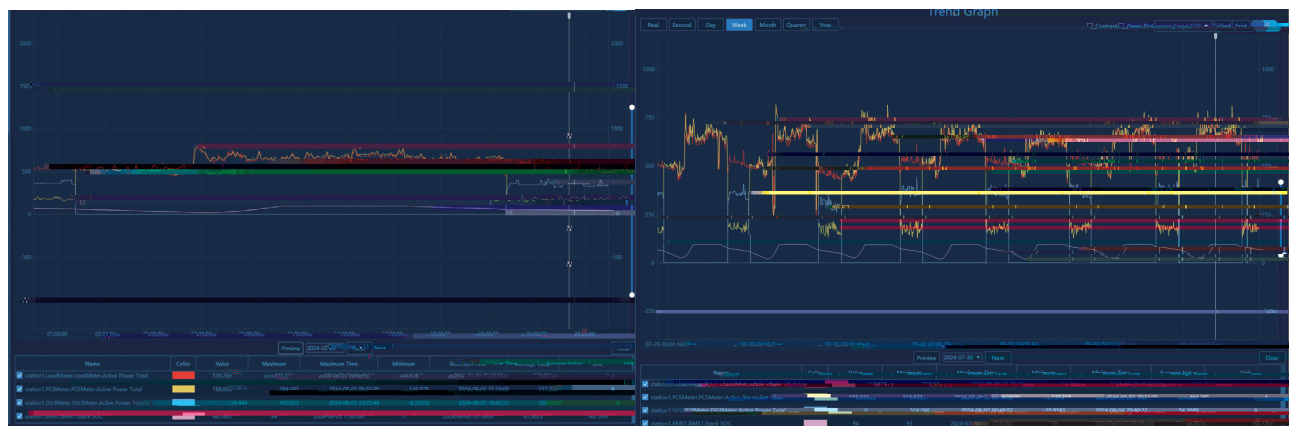

7,8. EMS

MW

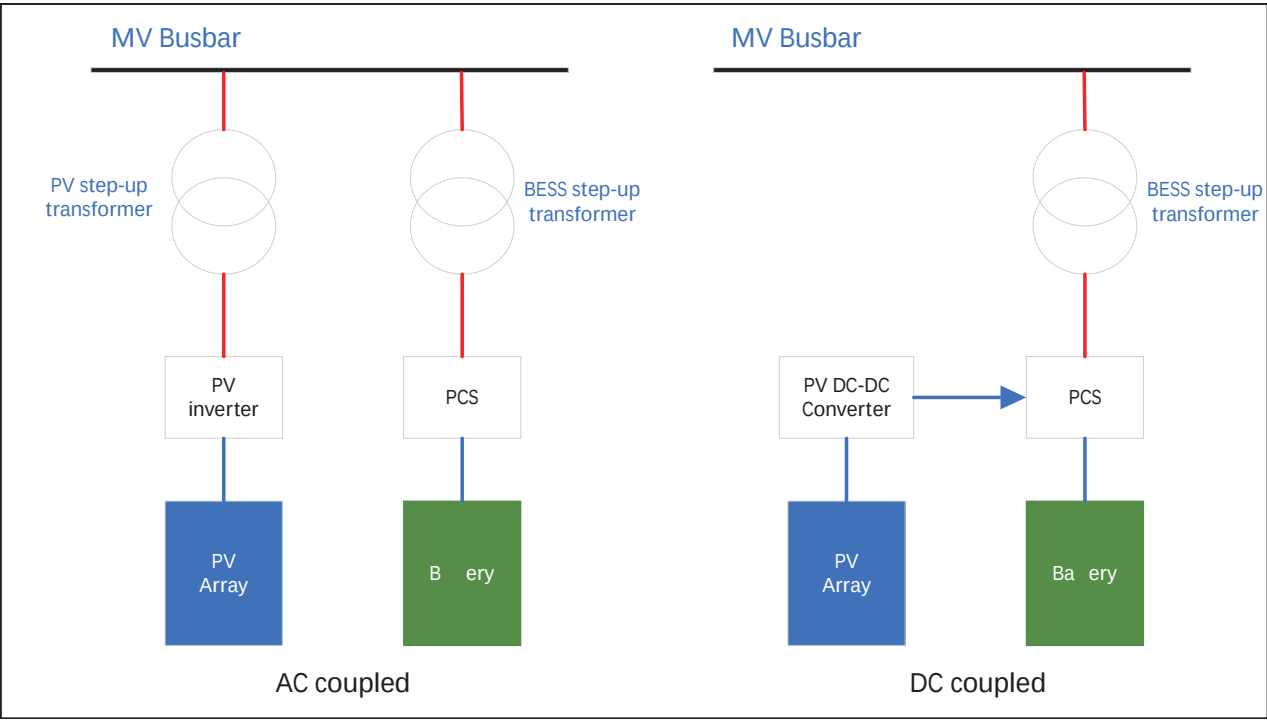



10.

*



1466 1
+86 400 860 8878

Case Study

3.45MW-6.88MWh

5MWp