


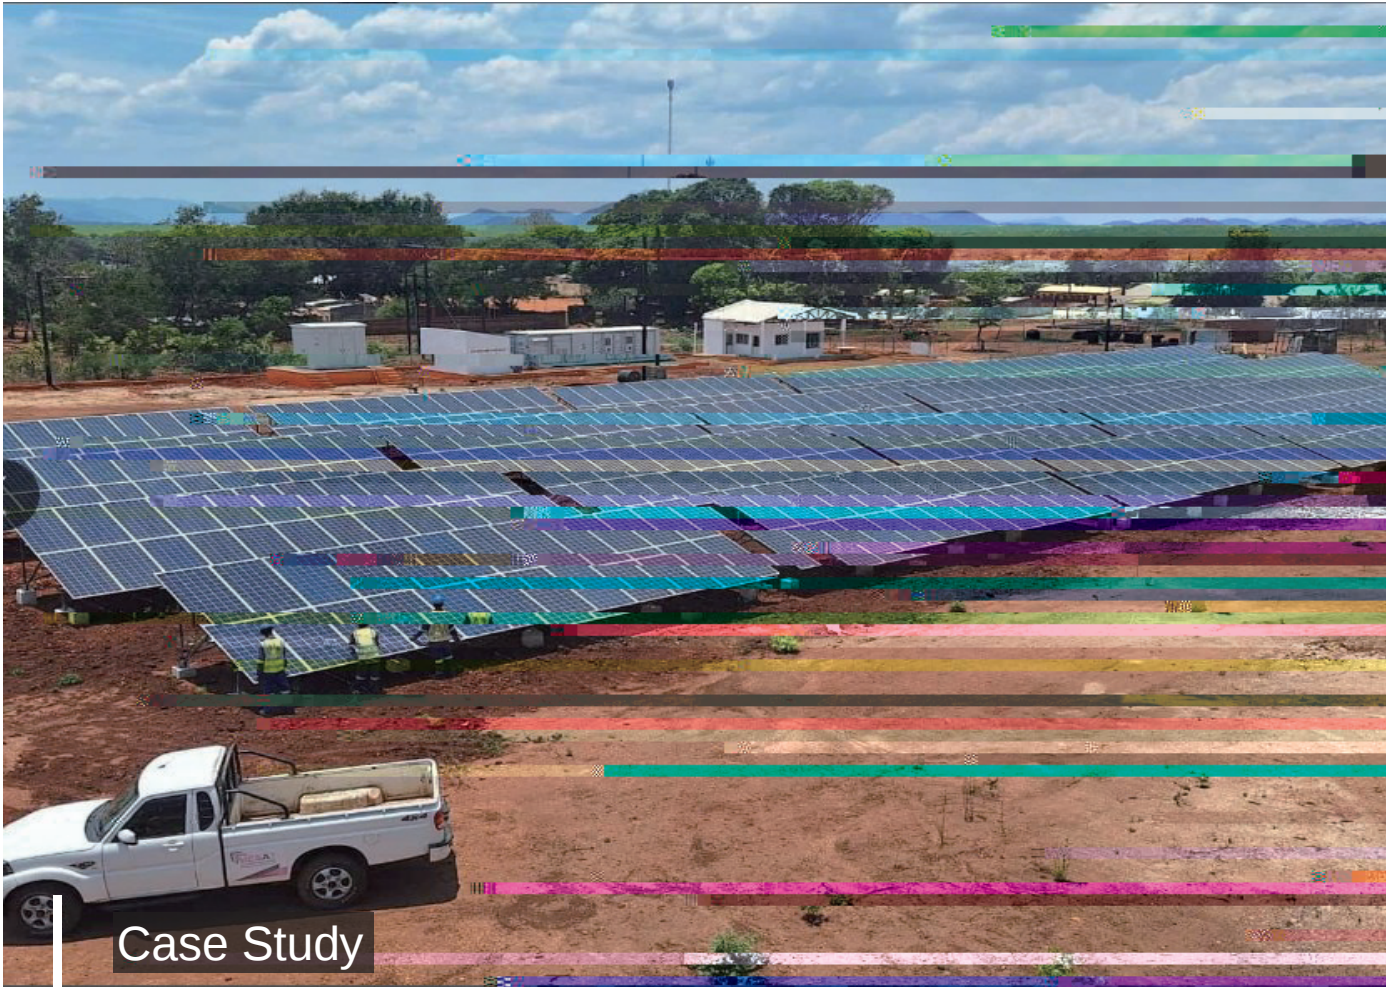

Case Study


250kW/945kWh

1%


PV

31.1%

ESS

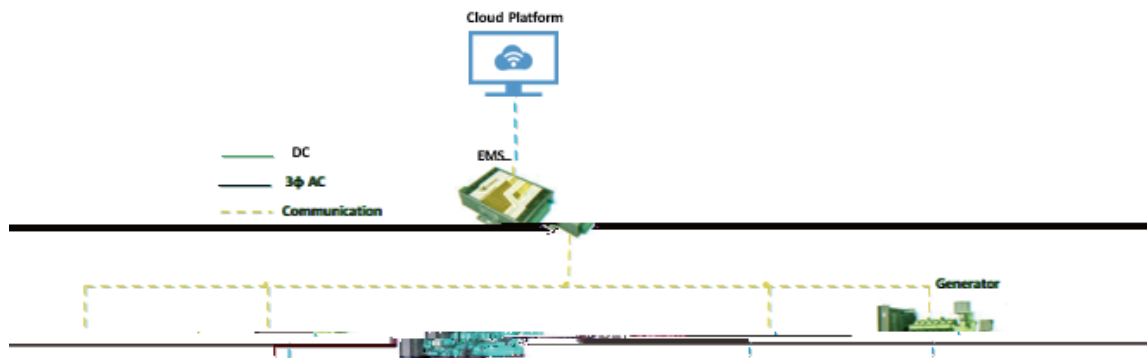


	945kWh	LFP		
250kW		PCS	250kW	-
	DC-DC Converter	200kWp		100 kVA

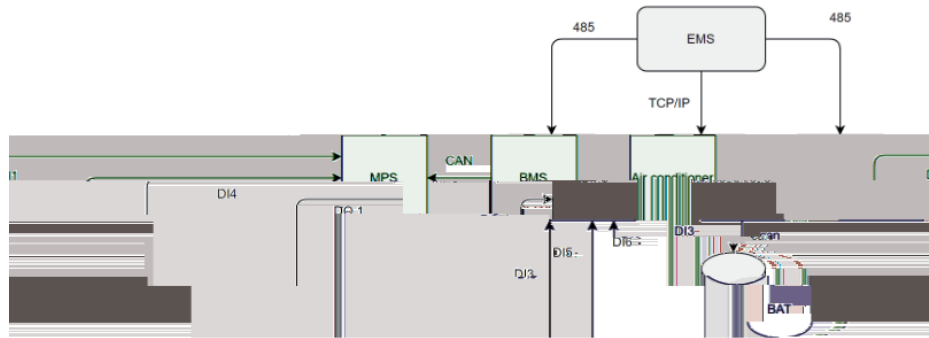

2

ESS

PV

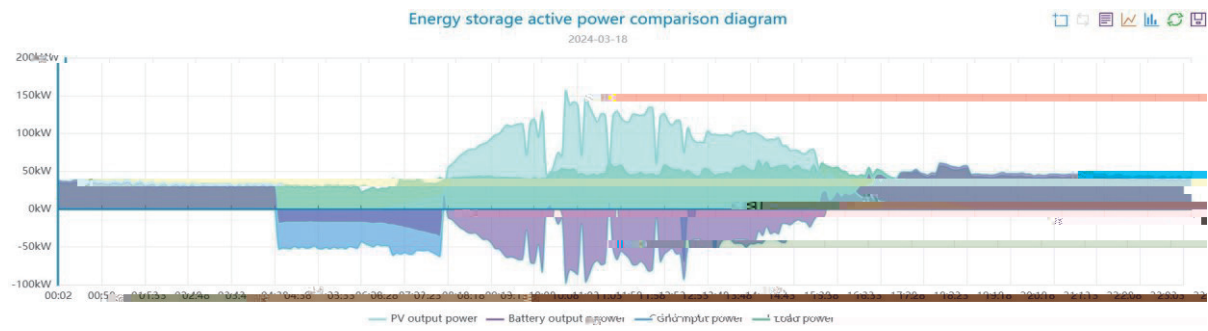

3 Jinko ESS

I.

a.

DC + PV-ESS

c.

DC

+

b.

DC

DC/AC

DC

+

PV-ESS

DC/DC

I.

a.

DC

DC/DC

b.